



SERIES PG, P12G

TYPE: _____
 CATALOGUE #: _____
 NOTES: _____



Industrial/Commercial Unit Equipment— 6 or 12 Volt Maintenance-free Lead Calcium Battery



Application Traditional styling designed to meet most requirements for moderate loads. Reliable, economic units for all public areas.

Features

- **HOUSING:** Heavy duty steel case with front access panel and mist white enamel finish.
- **MOUNTING:** Conduit knockouts and rear keyhole mounting slots are provided.
- **ELECTRONICS:**
 - Automatic, temperature compensated, pulse type charger.
 - High capacity, automatic, dust-tight instantaneous transfer relay.
 - Low voltage disconnect prevents over discharge of battery. Automatic brownout protection is provided.
 - Labor saving AC line latch prevents battery discharge during installation to a non-energized circuit.
 - Fused output circuit (PG2, P12G1).
 - Optional self-testing in accordance with NFPA 101, Life Safety Code. Unit tests itself every thirty days for one minute, thirty minutes on the sixth month and ninety minutes annually.
- **CONTROLS:**
 - Charge monitor LED indicates state of charge of the battery.
 - AC-ON LED indicates AC power is on.
 - Momentary test switch allows for quick operational check of entire system.
- **POWER REQUIREMENTS:**
 120/277Vac, 60 Hz, 0.25/0.12A

Battery

6 or 12 volt, long life, maintenance-free sealed lead calcium.

Lamp Heads

PAR 36 size, high impact resistant thermoplastic heads, furnished with high intensity incandescent lamps.

Note: Tungsten halogen lamps optional. See lamp chart.

Accessories

(Order as separate item) **Model**
 Wire Guard (A cabinet)**WG2-L**
 Wire Guard (B cabinet)**WG3-L**
 Mounting Platform**MP-PQA**

Options


(Add Suffix to Model No.) Suffix
 Black Housing and Heads**-B**
 Ammeter/Voltmeter
 (Not available with diagnostics)**-A or -V***
 Lamp Disconnect Switch**-DS**
 Improved Diagnostics**-ID**
 Improved Diagnostics (non-audible)**-IDNA**
 Time Delay**-TD****
 3-wire Cord & Plug**-3CP**
 3-wire Cord & Plug (277V).....**-3CP-277**
 NYC Approved**-NY**
 Chicago Approved**-CH**
 PAR18 size heads**-ELF2**
 * Choose only one "-A" or "-V"
 ** Not required with ID/IDNA option

Unit Selection Chart:

Each unit furnished with two 9W High Intensity incandescent lamp.

| Volts | Model No. (unit/Lamp Suffix) | Capacity in Watts to 87 1/2 % of Nominal Battery Voltage | | | |
|-------|------------------------------------|---|-----------|--------|--------|
| | | 1 1/2 Hrs. | 2 Hrs. | 3 Hrs. | 4 Hrs. |
| | | 6 | 2PG1/L9-M | 18 | 15 |
| | 2PG2/L9-M | 54 | 36 | 27 | 18 |
| 12 | 2P12G1/L9-M | 54 | 36 | 27 | 18 |

Specifications For Series PG, P12G

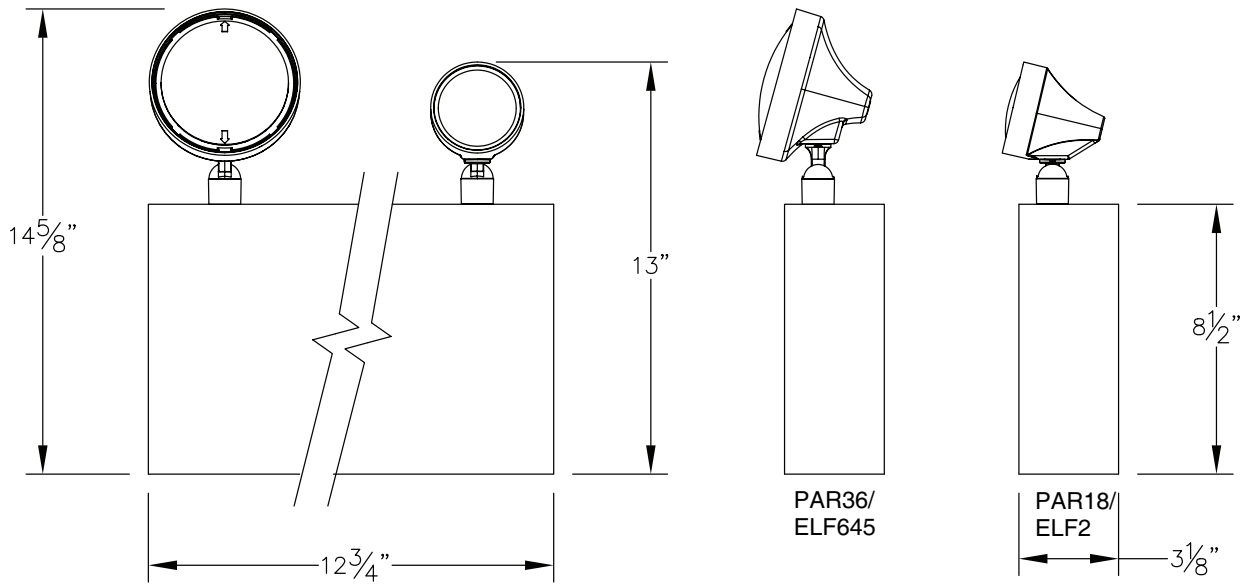

| Cabinet | Dimensions | | | |
|---------|--------------------|---------|---------|---------|
| | a | b | c | d |
| A | 14-5/8" // 13" | 12-3/4" | 3-1/8" | 8-1/2" |
| B | 16-3/8" // 14-3/4" | 16-1/8" | 5-7/16" | 10-1/4" |

GENERAL: The contractor shall furnish and install 6 or 12V emergency lighting units, as indicated on all plans. Input power shall be 120/277Vac, 60 Hz.

HOUSING: The battery and all components shall be housed in a compact 20 gauge steel case, with front access cover. Finish shall be mist white enamel.

LAMP HEADS: The unit shall be provided with one, two (or three for PG2, P12G1) standard PAR36 emergency heads constructed of high impact thermoplastic material, with access to lamp for replacement and finished in a color to match the unit. The heads shall be fully adjustable horizontally and vertically without tools. Optional heads available.

BATTERY: Unit shall contain a 6 or 12V sealed, non-refillable, maintenance-free lead calcium battery. Capacity shall be as shown in Unit Selection Chart.

TRANSFER: The sealed dust-tight transfer relay shall automatically and instantaneously connect the DC lamp load to the battery upon failure of the normal AC supply, and shall disconnect the DC lamps when normal power is restored.

CHARGER ASSEMBLY: An automatic, temperature compensated, pulse type charger shall be provided. The charger shall be reverse polarity protected, short circuit proof and capable of recharging the battery in accordance with UL924.

A low voltage disconnect shall be provided to shut off the lamp load and circuitry when battery reaches 87 1/2% discharge to protect battery from possible damage due to deep discharge. **Brownout circuit** shall be provided which activates emergency mode when AC power dips below 80-85% of nominal voltage. **AC line latch** circuit shall be provided which prevents battery discharge during installation to a non-energized circuit.

CONTROLS: **AC-ON LED** shall be provided to indicate the presence of AC power to the unit. **Charger monitor LED** shall be provided to indicate state of charge of the battery. **Momentary test switch** shall be provided to allow for periodic testing of the entire system.

WARRANTY: Entire unit (less lamps and fuses) shall carry a 3 year full warranty against defects in parts or workmanship under normal and proper use. The sealed lead calcium battery shall carry an additional 3 year pro-rata warranty.

MANUFACTURER:

Unit shall be Lightalarms Model _____

Ordering Information

Example: 2PG1/L9-M-DS

| Number of Heads | Series | Capacity Indicator | Lamp Option | Color | Options |
|-----------------|-------------|--------------------|---|-----------------------|-------------------------|
| 2 = 2 heads | PG = series | 1 = capacity | /L9 = lamp option <small>*See lamp data sheet for other lamp wattages.</small> | -M= mist white finish | -DS = disconnect switch |



Thomas & Betts